




**Davis County Environmental Health
Services Division Air Quality Bureau**

Report Date: 7/9/2014 8:20:27 AM
Report Date Range: 1/1/2013 to 1/1/2013
UserID: STOCKHOLMmikee
STATION: ALL

Overall GasCap Inspections - Initial and Retests

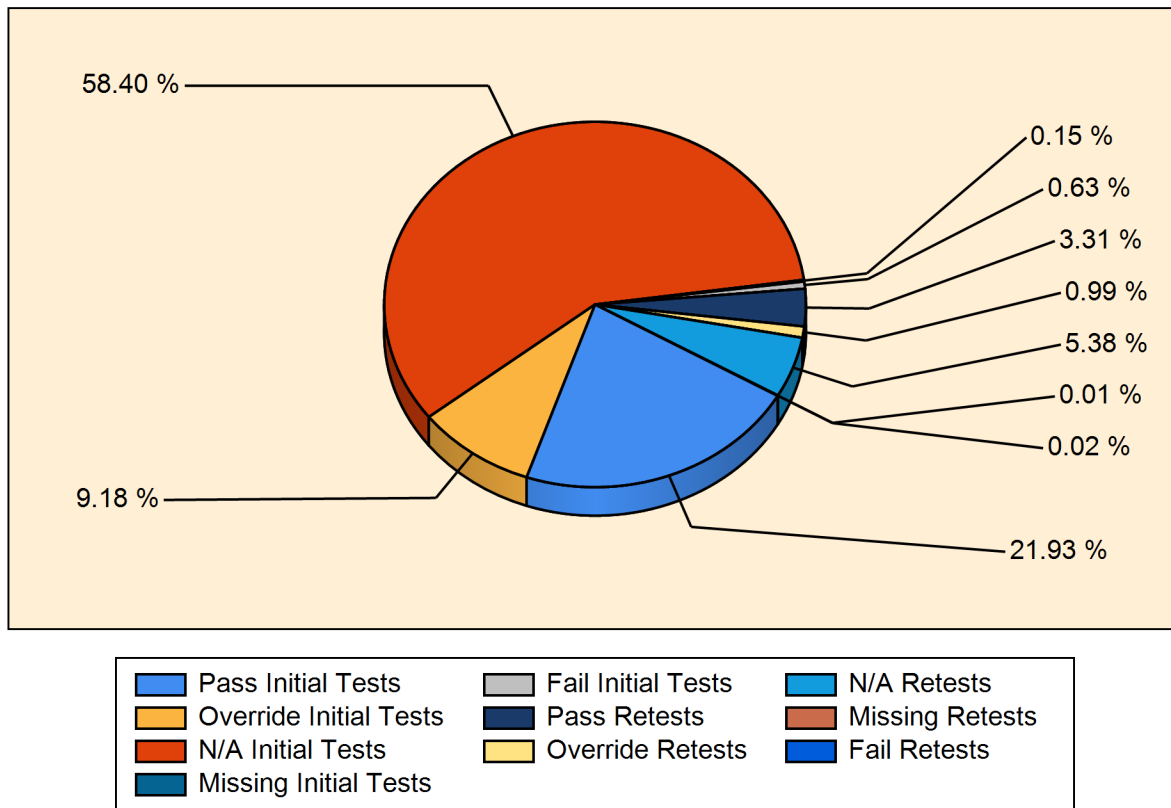

Overall Gas Cap Inspections - Initial and Retests

Gas Cap Inspections	Total	Percent
Pass Initial Tests	46943	21.93 %
Override Initial Tests	19663	9.18 %
N/A Initial Tests	125015	58.40 %
Missing Initial Tests	313	0.15 %
Fail Initial Tests	1343	0.63 %
Pass Retests	7090	3.31 %
Override Retests	2121	0.99 %
N/A Retests	11520	5.38 %
Missing Retests	32	0.01 %
Fail Retests	44	0.02 %
Total	214084	100 %